
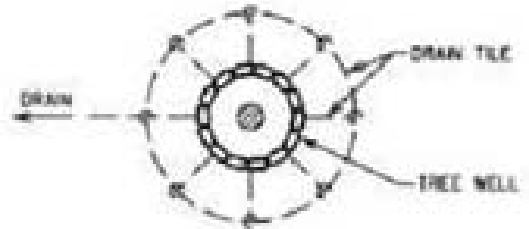
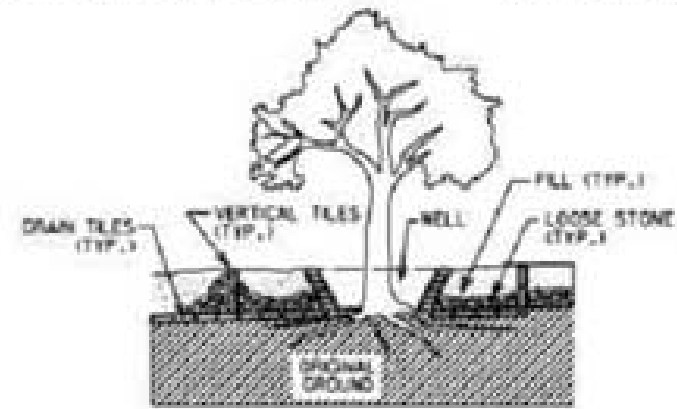


- THE STANDARD APPLIES ONLY UNDER THE FOLLOWING CONDITIONS:
- A. H AND Z ARE SPECIFIED ON THE DRAWING.
 - B. GROUNDWATER IS NO HIGHER THAN THE BOTTOM OF THE FOOTING.
 - C. THE MATERIAL BELOW THE FOOTING IS FIRM AND STABLE.
 - D. THE MATERIAL BEHIND THE WALL HAS A LEVEL SURFACE.
 - E. THE MATERIAL IN FRONT OF THE WALL HAS A SLOPE NO STEEPER THAN 4 HORIZONTAL TO 1 VERTICAL.
 - F. THE FACE OF THE WALL IS NO STEEPER THAN 1 HORIZONTAL TO 2 VERTICAL.
 - G. SURCHARGE LOADS BEHIND THE WALL ARE NO CLOSER THAN DISTANCE H FROM THE TOP OF WALL.

- NOTES:
1. DESIGN AND CONSTRUCTION OF ROCK WALL SHALL CONFORM TO THE REQUIREMENTS OF CITY CODE 16-7-2, PLACEMENT OF FENCES IN STREET CORNER AREAS AND THE CITY OF AUSTIN TRANSPORTATION CRITERIA MANUAL FOR MINIMUM SOFT DISTANCE.
 2. CONCRETE SHALL CONFORM TO ITEM 403, 'CONCRETE FOR STRUCTURES'.

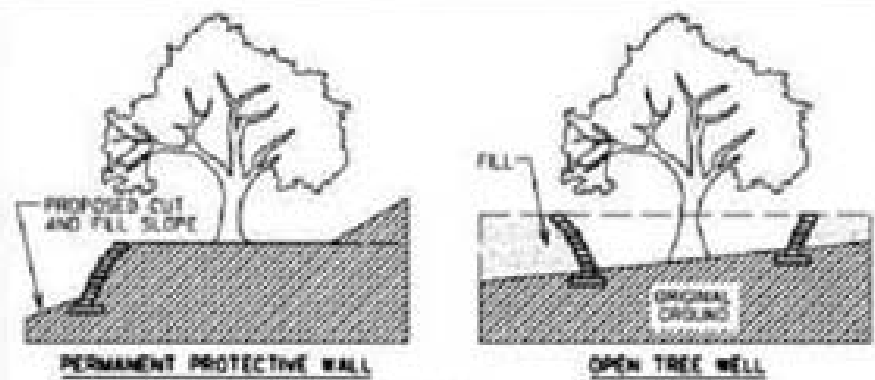

TREE WELL WITH RAISED GRADE

CITY OF AUSTIN WATERBURY PROTECTION DEPARTMENT		TREE PROTECTION, TREE WELLS	
RECORD COPY SIGNED BY J. PATRICK MURPHY	3/27/10 ADOPTED	THE ARCHITECT-ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD.	STANDARD NO. 610S-6 1 OF 2

CITY OF AUSTIN WATERBURY PROTECTION DEPARTMENT		TREE PROTECTION, TREE WELLS	
RECORD COPY SIGNED BY J. PATRICK MURPHY	3/27/10 ADOPTED	THE ARCHITECT-ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD.	STANDARD NO. 610S-6 2 OF 2